



HIGHLY PRECISE PRESSURE TRANSMITTERS FOR HAZARDOUS APPLICATIONS



SERIES 33 X Ei / 35 X Ei 36 XW Ei / PD-33 X Ei

These pressure transmitters are all ATEX approved for use in Hazardous Areas where there is a high risk of explosion.

- | | |
|-------------------|---|
| Series 33 X Ei | Industrial applications, male pressure port G1/4" |
| Series 35 X Ei | Flush diaphragm |
| Series 36 XW Ei | Level transmitter |
| Series PD-33 X Ei | Differential pressure measurement |


Digital Output of Transmitter

These Series are based on the stable, floating piezoresistive transducer and a micro-processor with integrated 16 bit A/D converter. Temperature dependencies and non-linearities of the sensor are mathematically compensated. With the READ30 software and the KELLER cable K-107, the calculated pressure can be displayed on a Palmtop, Laptop or PC. The READ30 software also allows the recording of pressure signals and the graphic display on the PC. Up to 128 transmitters can be hooked together to a Bus-system.

Transmitter with Analog Output

Integrated in the processor is a D/A converter of 16 bit for analog signal outputs of 4...20 mA or 0...10 V. The output rate is 400 Hz resp. 100 Hz (adjustable). The accuracy is diminished by this converting process by 0,05 %FS. The digital output is also available on analog transmitters with cable connection.

Ex-Classification:

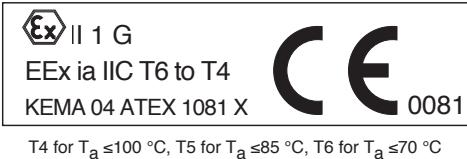


Series 33 X Ei

Series 35 X Ei

Series 36 XW Ei

Series PD-33 X Ei

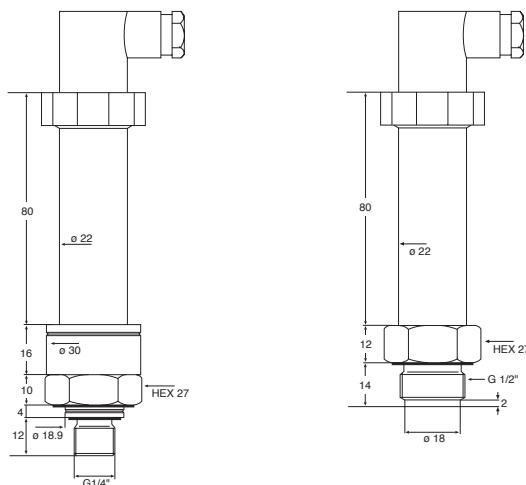

Series 33 X Ei (G1/4")

Series 35 X Ei (G1/2")

PIN ASSIGNMENT

Output	Function	DIN 43650	Cable
4...20mA	OUT / GND	1	white
2 Wire	+Vcc	3	black
0...10V	GND	1	white
3 Wire	OUT	2	red
	+Vcc	3	black
Digital	RS485A	-	blue
	RS485B	-	yellow
Transmitter Housing			Screen

Plan Serie 36 XW Ei and PD-33 X Ei available on request.

Subject to alterations

08/04



KELLER

SPECIFICATIONS

STANDARD PRESSURE RANGES (FS) AND OVERPRESSURE IN BAR

PR-33 X Ei, PR-35 X Ei, PR/PA(A)-36 XW Ei PA(A)-33 X Ei, PA(A)-35 X Ei (pressure ranges Series PD-33 X Ei on request)	1 0,8...1,2	3 3	10 30	30 100	1000 300	1000	All intermediate ranges for the analog output are realizable with no surcharge by spreading the standard ranges. Option: Adjustment directly to intermediate ranges (below 20 pieces against surcharge).
Overpressure	2	5	20	60	200	400	1000

Output	(digital) RS 485	(analog) 4...20 mA (2-wire)	(analog) 0...10 V (3-wire)	The transmitters must only be used in combination with certified intrinsically safe equipment!
Supply (U)	10...28 Vcc	10...28 Vcc	15...28 Vcc	
Accuracy, Error Band (10...40 °C)	0,05 %FS	0,1 %FS	0,1 %FS	
Accuracy, Error Band (-10...80 °C)	0,1 %FS	0,15 %FS	0,15 %FS	
Optional: Precision * (10...40 °C)	0,025 %FS	-	-	

* Only for Series PA(A)-33 X Ei and for ranges ≥ 10 bar.

True Output Rate (preset)	400 Hz (33 X Ei)	100 Hz (35 X Ei, 36 XW Ei)
Resolution	0,002 %FS	
Long Term Stability typ.	Ranges ≤ 2 bar: 1 mbar	
	Ranges > 2 bar: 0,1 %FS	

Load Resistance (Ω)	<(U-10V) / 0,02A (2-wire)	> 5'000 (3-wire)
Electrical Connection	DIN 43650 Plug (4 pole), cable	
Insulation	100 MΩ / 500 V	
Operating Temperature Range	-40...+80°C if an explosive atmosphere may be present continuously, frequently or for long periods. -40...+100°C for other applications	
Pressure Endurance	10 Million Pressure Cycles 0...100 %FS at 25 °C	
Vibration Endurance, acc. to IEC 68-2-6	20 g (5...2000 Hz, max. amplitude ± 3 mm)	
Shock Endurance	20 g (11 ms)	
Protection	IP65 optional: IP 67 or IP68 (with cable)	
CE-Conformity	EN 61000-6-1 to -6-4	
Material in Contact with Media	Stainless Steel 316L (DIN 1.4435) / Viton®	
Weight	Series 33 X Ei ≈ 140 g; Series 35 X Ei ≈ 160 g	
Dead Volume Change	< 0,1 mm³	

Options: - Spécial calculations with pressure and temperature
- Different housing-material, oil filling, pressure thread

Polynomial Compensation

This uses a mathematical model to derive the precise pressure value (P) from the signals measured by the pressure sensor (S) and the temperature sensor (T). The microprocessor in the transmitter calculates P using the following polynomial:

$$P(S,T) = A(T) \cdot S^0 + B(T) \cdot S^1 + C(T) \cdot S^2 + D(T) \cdot S^3$$

With the following coefficients A(T)...D(T) depending on the temperature:

$$\begin{aligned} A(T) &= A_0 \cdot T^0 + A_1 \cdot T^1 + A_2 \cdot T^2 + A_3 \cdot T^3 \\ B(T) &= B_0 \cdot T^0 + B_1 \cdot T^1 + B_2 \cdot T^2 + B_3 \cdot T^3 \\ C(T) &= C_0 \cdot T^0 + C_1 \cdot T^1 + C_2 \cdot T^2 + C_3 \cdot T^3 \\ D(T) &= D_0 \cdot T^0 + D_1 \cdot T^1 + D_2 \cdot T^2 + D_3 \cdot T^3 \end{aligned}$$

The transmitter is factory-tested at various levels of pressure and temperature. The corresponding measured values of S, together with the exact pressure and temperature values, allow the coefficients A0...D3 to be calculated. These are written into the EEPROM of the microprocessor.

When the pressure transmitter is in service, the microprocessor measures the signals (S) and (T), calculates the coefficients according to the temperature and produces the exact pressure value by solving the P(S,T) equation.

Calculations and conversions are performed at least 400 times per second.

ACCESSORIES SERIES 30

The transmitter with cable may be connected to a PC or Laptop via a converter RS232-RS485. If the converter is not intrinsically safe (i.e. K-102, K-104 or K-107), the programming must take place outside of the area where there is a high risk of explosion. Two programs are offered:

PROG30:

Instrument Settings

- Call up of information (pressure- and temperature range, version of software etc.)
- Indication of actual pressure value
- Selection of the units
- Setting of a new zero and gain for the transmitter
- Reprogramming of the analog output (i.e. different unit, other pressure range)
- Setting of the instrument address (for Bus-operation)
- Changing the true output rate


You can also tie up the transmitters into your own software. You have then a documentation, a DLL and numerous examples at your disposal.

READ30:

Data collection with graphs

- Fast read-out and viewing of the pressure signals in a graph
- Documentation of dynamic measurements
- Up to 16 transmitters on one serial connection (Bus-operation)

SOFTWARE PROG30

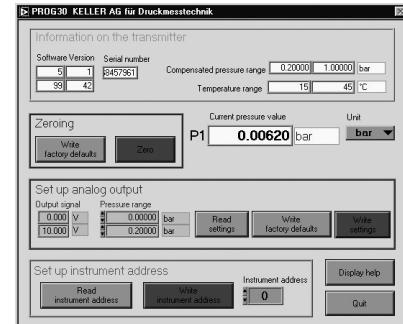

Subject to alterations

08/04

KELLER AG für Druckmesstechnik
KELLER Gesellschaft für Druckmesstechnik mbH

St. Gallerstrasse 119
Schwarzwaldstrasse 17

CH-8404 Winterthur
D-79798 Jestetten

Tel. 052 - 235 25 25
Tel. 07745 - 9214 - 0

Fax 052 - 235 25 00
Fax 07745 - 9214 - 50